



**BOARD OF  
PARKS AND  
RECREATION  
COMMISSIONERS**  
CITY OF  
KANSAS CITY, MISSOURI


4600 E. 63rd Street  
Kansas City, MO 64130  
Bus: (816) 513-7500  
Fax: (816) 513-7605  
Web: www.kcmo.org/parks

## KCMO PARK'S STANDARD DETAILS

DC  
COMMERCIAL DRIVEWAY

DESIGNER: T. KIEFER  
DATE: 15 FEB 2013  
ARCHIVE NO:

**DC**  
STANDARD DRAWING NO.

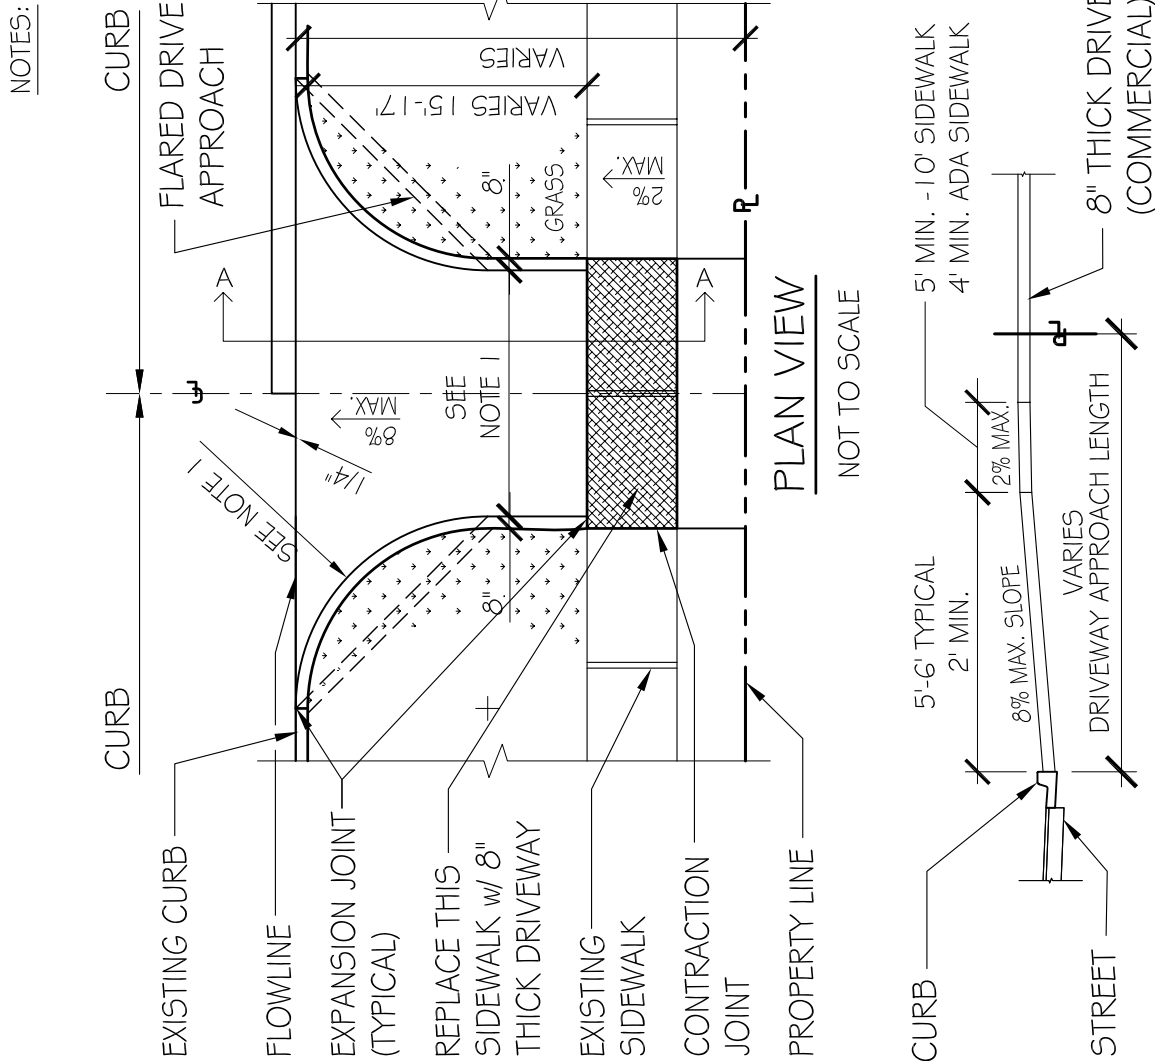

NOTES:

1. CONFIGURATION: MAXIMUM NEW DRIVEWAY 25'-0" WIDTH. OLD DRIVEWAYS SHALL BE REBUILT AT EXISTING WIDTH. NO DRIVEWAYS WITHIN 5'-0" OF STREET TREE PERMITTED. MAXIMUM WIDTH OF JOINT DRIVEWAYS OF ABUTTING PROPERTY OWNERS LIMITED TO 12'-0". MAXIMUM 10'-0" RADIUS. MINIMUM 8'-0" RADIUS. 8" MINIMUM THICKNESS.
2. CONCRETE: 8 INCH MINIMUM THICKNESS; 4,000 PSI STRENGTH @ 28 DAYS; 4 INCHES ± 1 INCH SLUMP; AND 6% ± 1% AIR ENTRAINMENT.
3. PLACEMENT: ON 4" THICK AB3 GRAVEL BASE OVER SUB-GRADE, EACH COMPACTED TO 95% MAXIMUM DENSITY AT OPTIMUM MOISTURE. MATCH EXISTING STREET CURB ELEVATION AND TYPE. CURB OR DRIVEWAY TO DECREASE IN HEIGHT OR TO DISAPPEAR AT SIDEWALK. SLOPE SIDEWALKS 2% MAXIMUM AND DRIVEWAYS A MAXIMUM OF 8% TO DRAIN INTO FLOW LINE OF GUTTER. PARKS & RECREATION TO INSPECT FORMS PRIOR TO PLACEMENT OF CONCRETE.
4. REINFORCING: 6x6-W2.9xW2.9 WELDED WIRE FABRIC ON 2 INCH HIGH CHAIRS @ 24" O.C..
5. EXPANSION JOINTS AND CONTRACTION JOINTS: SEE STANDARD CONCRETE JOINT DETAIL.
6. FINISHING: ALL EDGES TO BE ROUNDED TO 1/4 INCH RADIUS, METAL FLOAT THEN LIGHT BROOM.
7. CURING: ONE COAT OF WHITE PIGMENTED LIQUID MEMBRANE FORMING COMPOUND TYPE 2 IN ACCORDANCE WITH ASTM C-309, APPLIED AT 250-275 SQ FT/GALLON OR APPROVED EQUAL.
8. CONCRETE REMOVAL: SAW-CUT AT NEAREST CONTROL JOINT.
9. FORM 1/4" LIP AT PAVEMENT LINE ON DRIVES IN CURB5.
10. FLARED DRIVE APPROACHES WITH WIDTHS 14 FEET OR LESS SHALL BE 7.5 FEET WIDE AT CURB AND SHALL EXTEND AT A 45° ANGLE THROUGH THE SIDEWALK.

SECTION A-A

NOT TO SCALE

10' MIN. RADIUS ON MAX. 25' WIDE DRIVE  
10' MIN. RADIUS ON 11' WIDE DRIVE

NOT TO SCALE